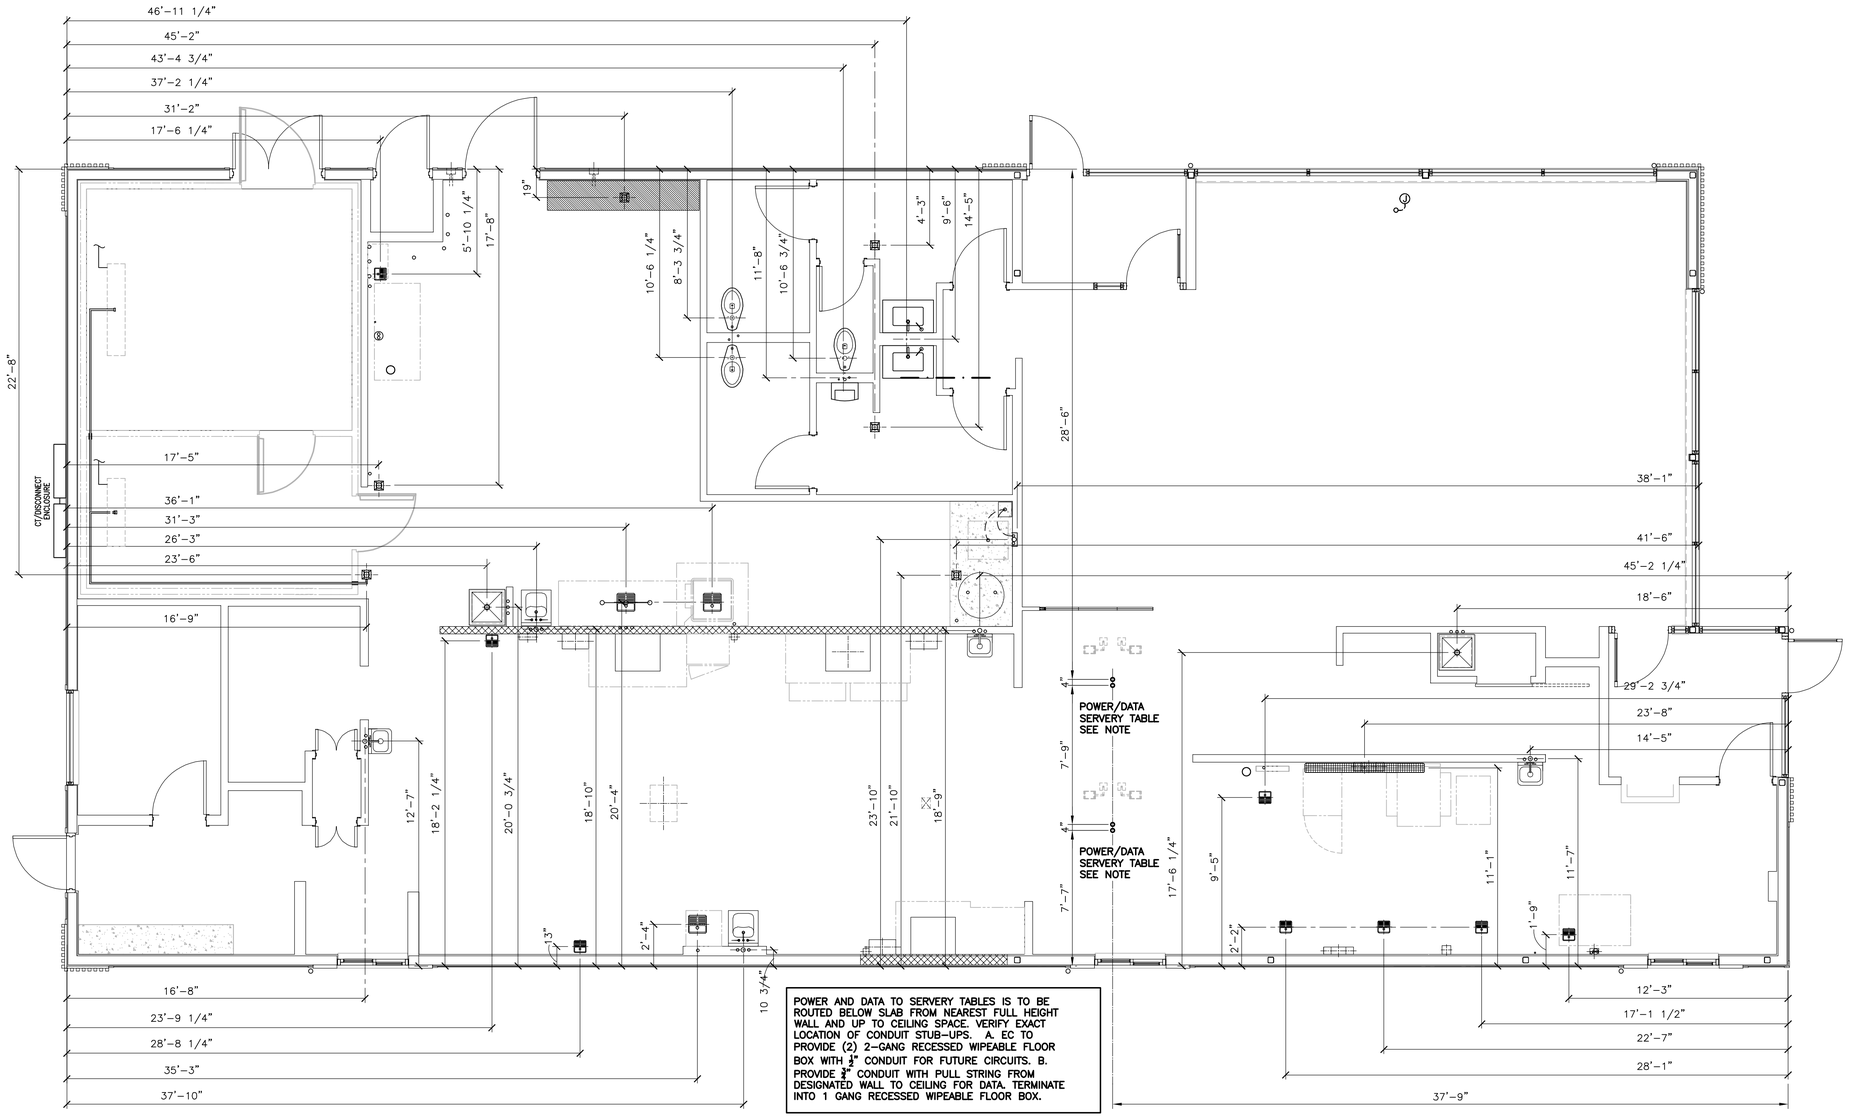


POWER AND DATA TO SERVERY TABLES IS TO BE ROUTED BELOW SLAB FROM NEAREST FULL HEIGHT WALL AND UP TO CEILING SPACE. VERIFY EXACT LOCATION OF CONDUIT STUB-UPS. A. EC TO PROVIDE (2) 2-GANG RECESSED WIPEABLE FLOOR BOX WITH ¾" CONDUIT FOR FUTURE CIRCUITS. B. PROVIDE 3" CONDUIT WITH PULL STRING FROM DESIGNATED WALL TO CEILING FOR DATA. TERMINATE INTO 1 GANG RECESSED WIPEABLE FLOOR BOX.

1 / P1.4 **UNDERGROUND ROUGH-IN**

SCALE: 1/4" = 1'-0"

DRAWING NOTES

1. THIS PLAN IS PROVIDED AS A GUIDE FOR THE PLUMBING CONTRACTOR. ALL DIMENSIONS ARE ROUNDED TO THE NEAREST ¼" AND ARE TAKEN FROM THE OUTSIDE EDGE OF THE FOUNDATION WALL TO CENTERLINE OF SLAB PENETRATION.

REV.	DATE	DESCRIPTION	BY
1	07/22/2026	PROTOTYPE UPDATES	
2	09/17/2026	GEOTECH UPDATES / T.E. UPDATE / CIVIL COORDINATION	

STATE OF MISSOURI — JERAMY ALLEN WILLIAMS — NUMBER A-2009035697 — ARCHITECT

PREPARED BY:
JAW Architects, Inc.
Jeramy Williams, Architect
Phone: 817-703-3387
Email: jeramy@jaw-works.com

PREPARED FOR:
McDonald's USA, LLC

© 2026 McDonald's USA, LLC
These drawing and specifications are the confidential and proprietary property of McDonald's USA, LLC and are not to be reproduced without written authorization. The contract documents were prepared for use on this specific site in conjunction with its issue date and are not suitable for reuse by any person on any other project. Reuse of these drawings for reference or example on another project requires the services of properly licensed architects and engineers. Reproduction of the contract documents for reuse on another project is not authorized.

DRAWN BY:	-
STD ISSUE DATE	2026
REVIEWED BY	JAW
DATE ISSUED	04/15/2026

TITLE: 2026 STANDARD BUILDING - BB20
4590-WOOD/WOOD

DESCRIPTION: WOOD BEARING WALLS
WOOD ROOF TRUSS FRAMING

SITE ID: 024-1329

SITE ADDRESS: SWC OF E NEW MELVILLE RD & S HUNT RD WILLARD, MO 65781

SHEET NO.: JAWA 26-0041
P1.4
UNDERGROUND ROUGH-IN